


Rev. **A** Dated 08.11.2007

Prepared By MZA

- Max. restraint load has been curtailed to 7000 Kgf.
- Used following special items:
 - PTFE Sliding plates ($\mu=0.05$)
 - Variable Spring cans (05 Nos.)
 - Constant spring can (01 No.)
 - Hinged Expansion joints, (4 revolutions from Sector Flexonic Pathway each) 4 Nos.
 - PTFE Sliding plates are not used at Node # 120, 192, 200, 350, 430, 450 & 510. At these nodes $\mu=0.3$.
- All assumptions have been attached as a separate sheet.

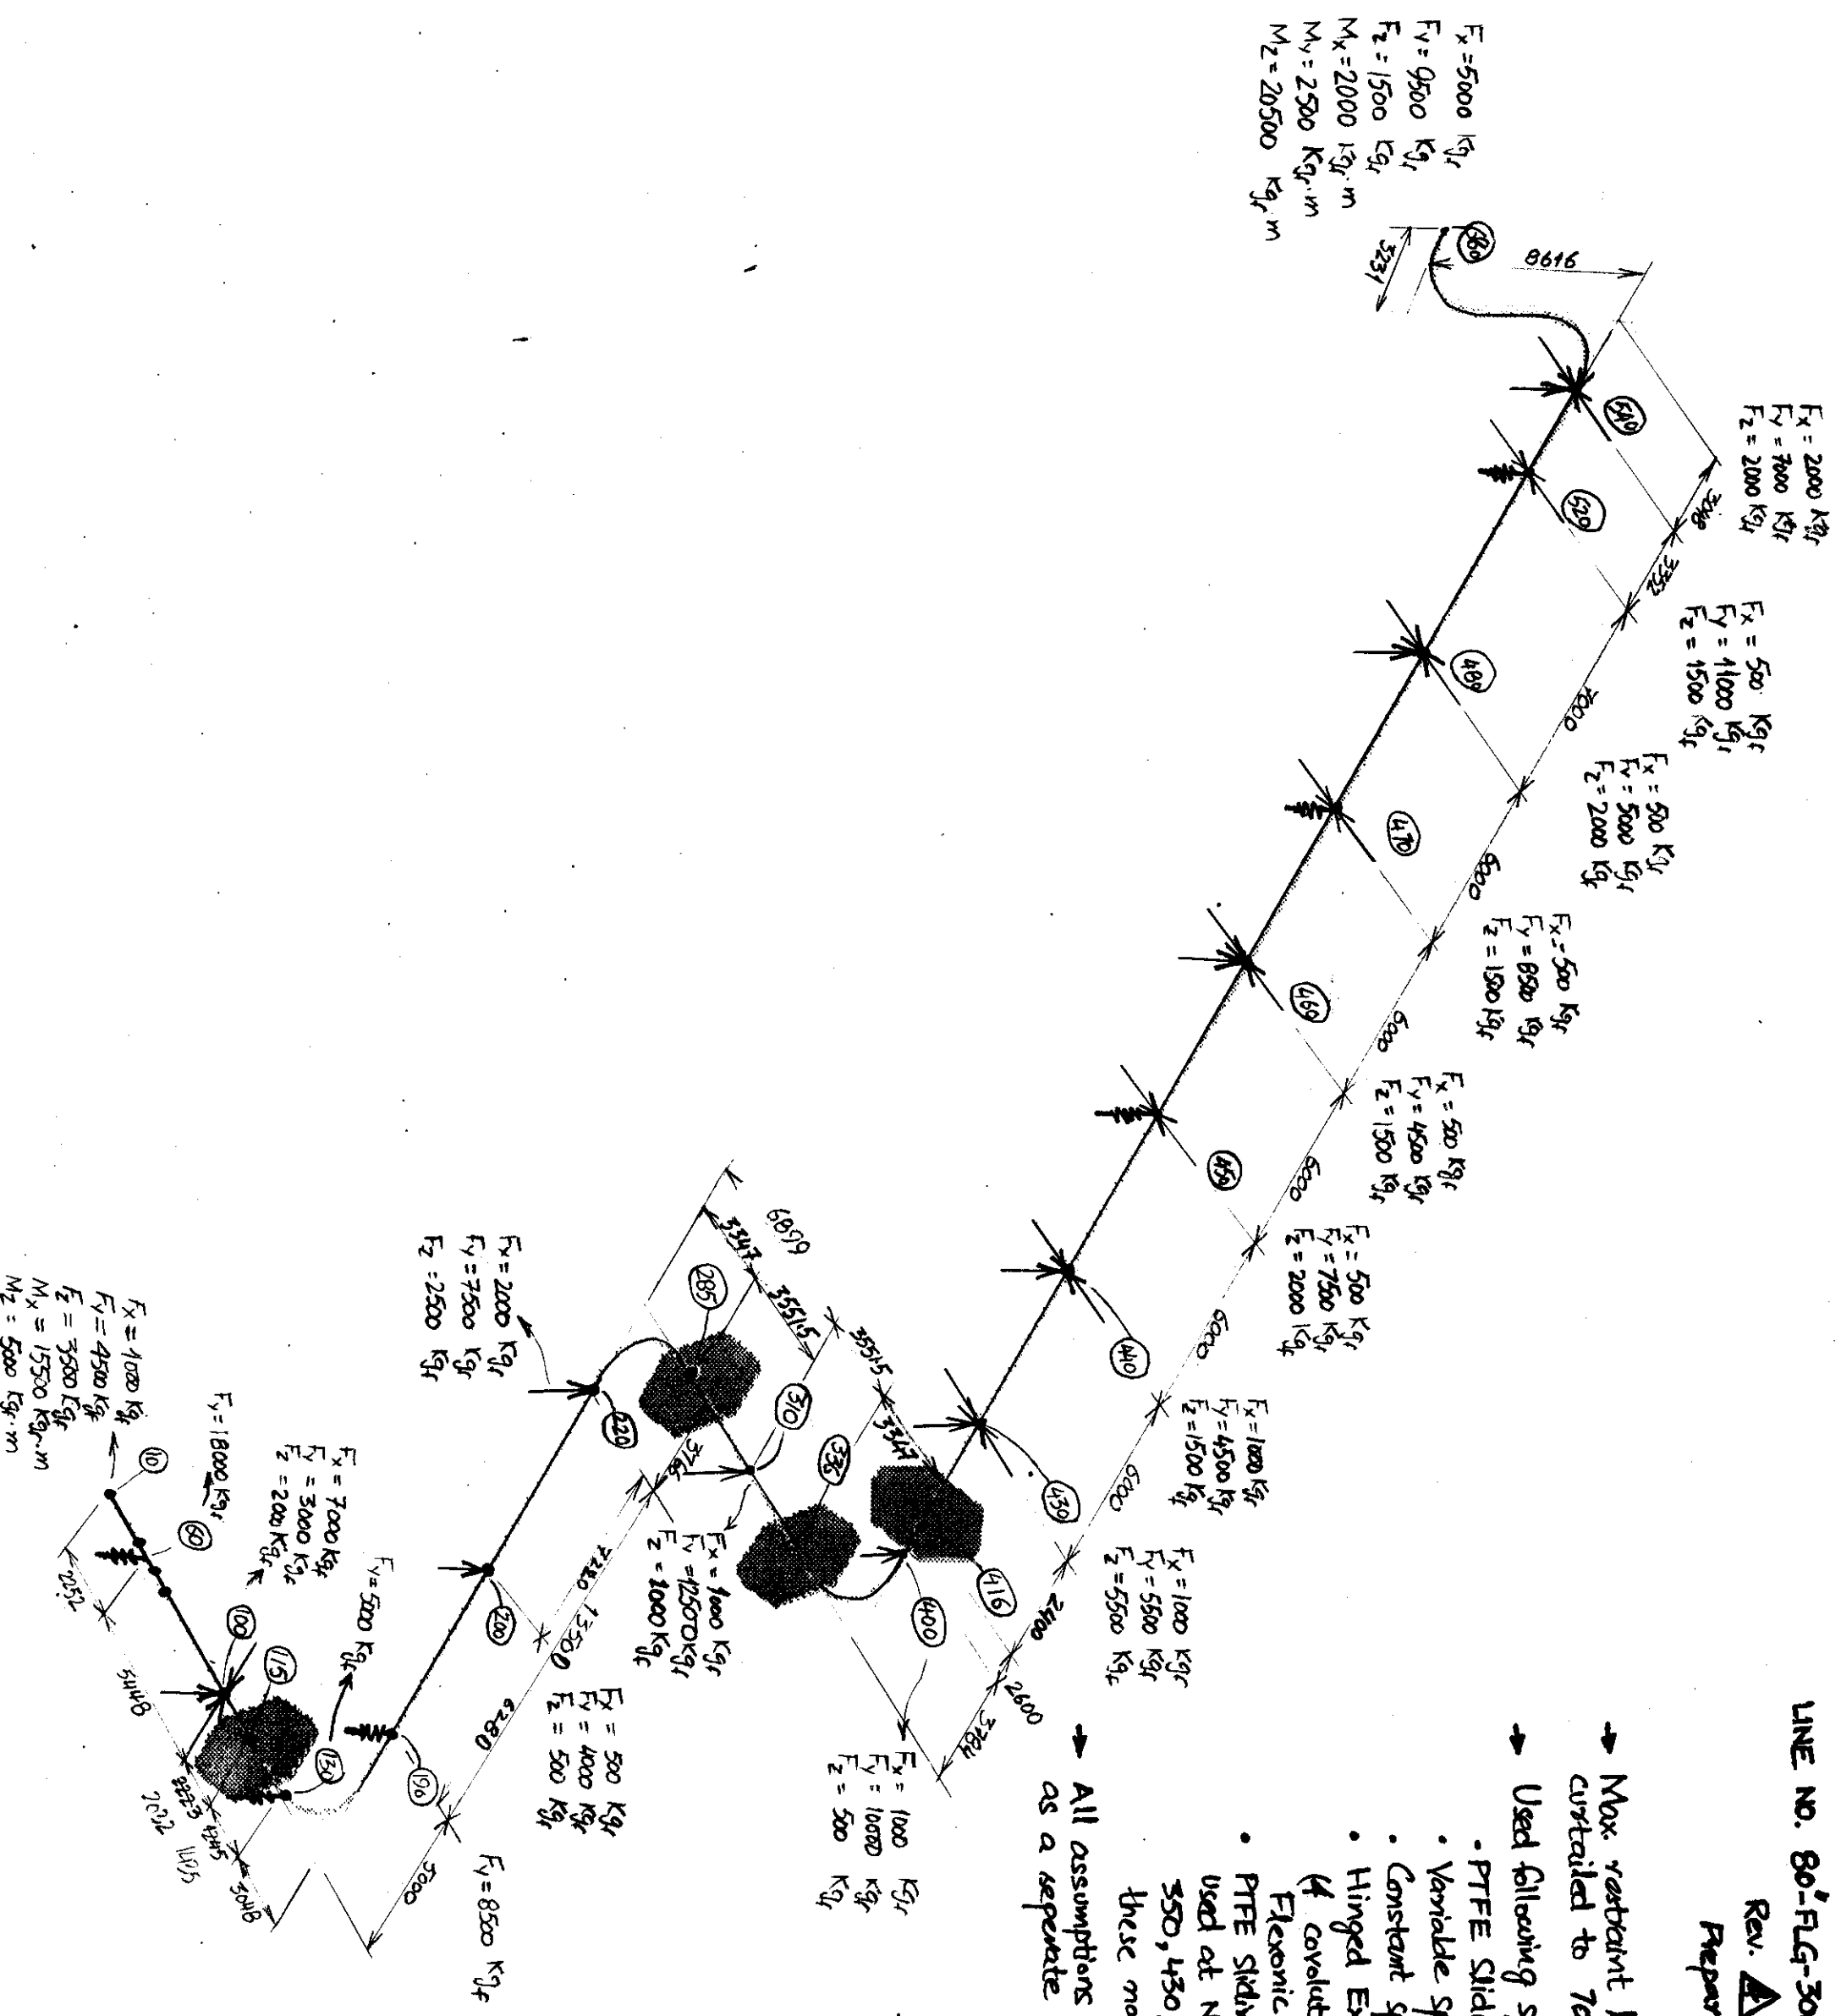

4 Conv each

